

Photometric Test Report

Relevant Standards

- ☒ IES LM-79-2008
- ☒ ANSI C82.77:2014

Prepared For

RAB Lighting Inc.

Room 6A33, No.1388, Wuzhong road, Shanghai, China

Xiao Xiang, 15921313292, gary.xiao@rabweb.com

Prepared By

Deliver Co., Ltd.

Block 11, 78 Keling Road, SSTP, Suzhou, China

0512-66801950, kevin.jia@szdeliver.com

Project Number

DLF1811113

Data Number

DLF1811113-8a

Test Date

2018/11/22

Issue Date

2018/11/23

Prepared By



Wangzun Zhu

Approved By



Kevin Jia

The results contained in this report pertain only to the tested sample.

This report shall not be reproduced, except in full, without written approval of Deliver Co., Ltd.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP.

1.0 Test Summary

DLC Technical Requirements v4.4

Outdoor - Mid output Outdoor Pole/Arm-Mounted Area and Roadway Luminaires			
Requirement Category	Test Method	Requirements	Test value
Lamp Output (lm)	IES LM-79-2008	5000	6949
Minimum Luminaire Efficacy (lm/W)	IES LM-79-2008	95	102.7
Zonal Lumen Requirement (0°-90°)	IES LM-79-2008	≥99%	100.00%
Zonal Lumen Requirement (80°-90°)	IES LM-79-2008	≤10%	3.91%
Allowable CCTs* (K)	IES LM-79-2008	≤5700	2986
Minimum CRI	IES LM-79-2008 CIE 13.3-1995	≥65	80.4
Power Factor	ANSI C82.77:2014	0.873	0.931
Total Harmonic Distortion (A%)	ANSI C82.77:2014	25.00%	11.12%

2.0 Test List

Test Item	Test	Test Date	Model Number	Sample No.
1	Integrating Sphere Test	2018/11/22	IVAT4-75L730[H, 4]	H1
2	Goniophotometer Test	2018/11/22	IVAT4-75L730[H, 4]	H1
3	THD and PF Test	2018/11/22	IVAT4-75L730[H, 4]	H1

Remark(If any)

- 1、 This report shall not be used by the client to claim product endorsement by NVLAP, NIST or any agency of the US government.
- 2、 The results reported herein have been performed in accordance with the laboratory's terms of accreditation. This report shall not be reproduced except in full without the written approval of the Laboratory. The results in this report apply to the test sample(s) mentioned above at the time of the testing period only and are not to be used to indicate applicability to other similar products. This report does not imply that the product(s) has met the criteria for certification.

3.0 Production Description

Luminaire Description: IVAT4-75L730[H, 4]

Electrical Specification: 480V,50/60HZ, 75W

Photos of Luminaire Characteristics



4.0 LM-79 Measurement and Test Results

4.1 Integrating Sphere Test

Model No.	IVAT4-75L730[H, 4]	Sample ID.	H1
Operate time (Min.)	90	Stabilization time (Min.)	45

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$.

The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.

The sample was measured using 4π geometry and operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

Test Conditions

Temperature ($^{\circ}\text{C}$)	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
25.3	480.00	60	0.152	67.9	0.931


Test Result

CCT (K)	CRI (Ra)	Duv
2986	80.4	1.9E-03

4.1 Integrating Sphere Test

Spectroradiometric Parameters

Results

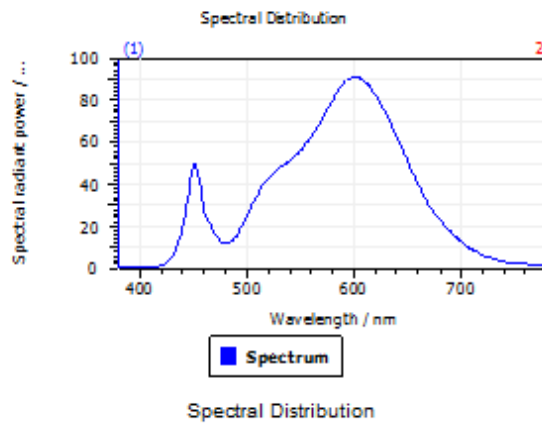


Spectral values

DominantWavelength	582.22 nm
Purity	0.555
PeakWavelength	601.40 nm
Width50%:	129.54 nm

Color Coordinates

Correlated Color Temperature		2986 K	
x: 0.4408	u: 0.2504	u': 0.2504	
y: 0.4103	v: 0.3496	v': 0.5244	
CRI01	77.9	CRI09	-1.5
CRI02	87.5	CRI10	71.4
CRI03	96.2	CRI11	78.1
CRI04	79.4	CRI12	61.7
CRI05	77.9	CRI13	79.8
CRI06	84.2	CRI14	97.8
CRI07	83.2	CRI15	70.0
CRI08	56.7	CRI16	68.2
ResultsCRI	80.4		

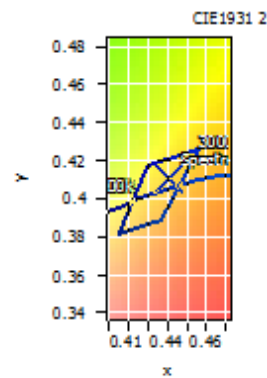

PlanckDistance 1.9E-003

4.0 LM-79 Measurement and Test Results

4.3 Goniophotometer Test

Model No.	IVAT4-75L730[H, 4]	Sample ID.	H1
Operate time (Min.)	90	Stabilization time (Min.)	45

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric parameters were measured using a type C goniophotometer and software.

The ambient temperature shall be maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$, measured at a point not more than 1 m from the sample and at the same height as the sample.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.

The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 0.5° vertical intervals and 10° horizontal intervals.

Test Conditions


Temperature ($^{\circ}\text{C}$)	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	Orientation
25.1	480.02	60	0.151	67.7	0.931	Light Down

Test Result


Flux (lm)	Zonal Lumen Requirement (0° - 90°)	Zonal Lumen Requirement (80° - 90°)	Field Angle(10%)		Beam Angle(50%)		Luminous Efficacy (lm/W)
			Horizontal Spread	Vertical Spread	Horizontal Spread	Vertical Spread	
6949	100.00%	3.91%	178.1	154.8	165.5	55.1	102.7

4.3 Goniophotometer Test

Light Distrubtion Curve

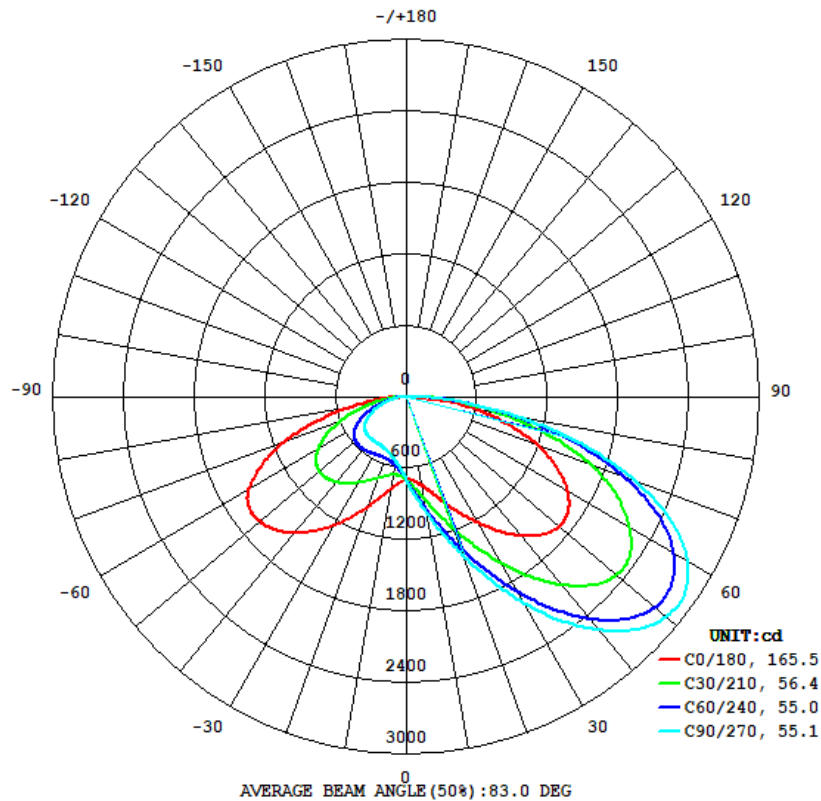

Isolux Plot

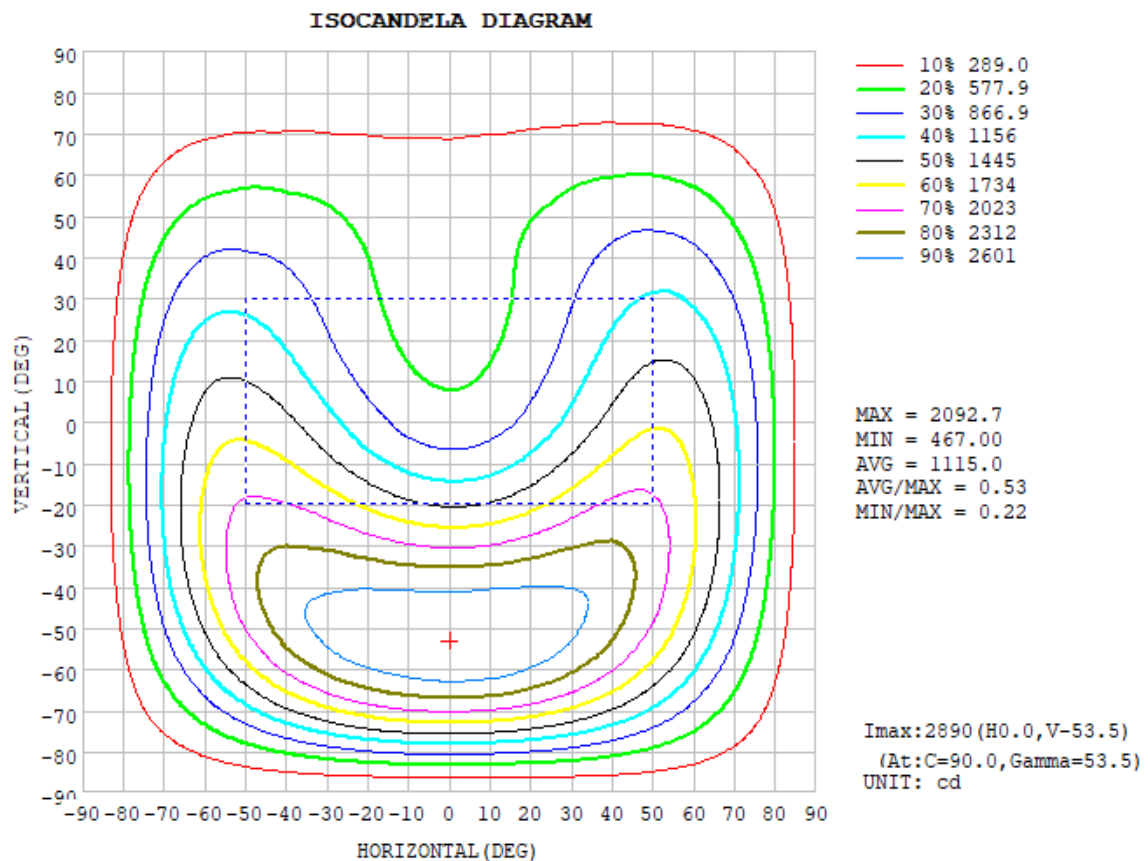

4.3 Goniophotometer Test

Zonal Lumen Summary

γ	C0	C45	C90	C135	C180	C225	C270	C315
10	754.2	906.2	976.2	923.9	782.8	621.1	551.7	615.2
20	943.0	1275	1415	1304	983.2	627.0	487.7	627.5
30	1226	1766	1993	1792	1244	674.4	468.4	693.2
40	1524	2279	2555	2268	1496	728.7	469.6	774.2
50	1697	2579	2872	2559	1631	737.1	457.3	805.3
60	1587	2449	2760	2505	1545	645.2	394.4	721.8
70	1184	1846	2071	1869	1108	440.0	266.7	503.7
80	573.6	892.0	960.0	848.8	464.0	174.1	100.7	209.6
90	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0
130	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0
DEG	LUMINOUS INTENSITY:cd							


4.3 Goniophotometer Test

ZONAL LUMEN SUMMARY

	Zonal (lm)		Total (lm)	Percent
0-10	69.90	0 - 10	69.90	1.01%
10-20	244.72	0 - 20	314.62	4.53%
20-30	508.19	0 - 30	822.81	11.84%
30-40	866.74	0 - 40	1689.55	24.31%
40-50	1241.93	0 - 50	2931.48	42.19%
50-60	1471.43	0 - 60	4402.91	63.36%
60-70	1374.78	0 - 70	5777.69	83.15%
70-80	899.34	0 - 80	6677.03	96.09%
80-90	271.84	0 - 90	6948.87	100.00%
90-100	0.00	0 - 100	6948.87	100.00%
100-110	0.00	0 - 110	6948.87	100.00%
110-120	0.00	0 - 120	6948.87	100.00%
120-130	0.00	0 - 130	6948.87	100.00%
130-140	0.00	0 - 140	6948.87	100.00%
140-150	0.00	0 - 150	6948.87	100.00%
150-160	0.00	0 - 160	6948.87	100.00%
160-170	0.00	0 - 170	6948.87	100.00%
170-180	0.00	0 - 180	6948.87	100.00%

3.2 Goniophotometer Test

LCS Graph

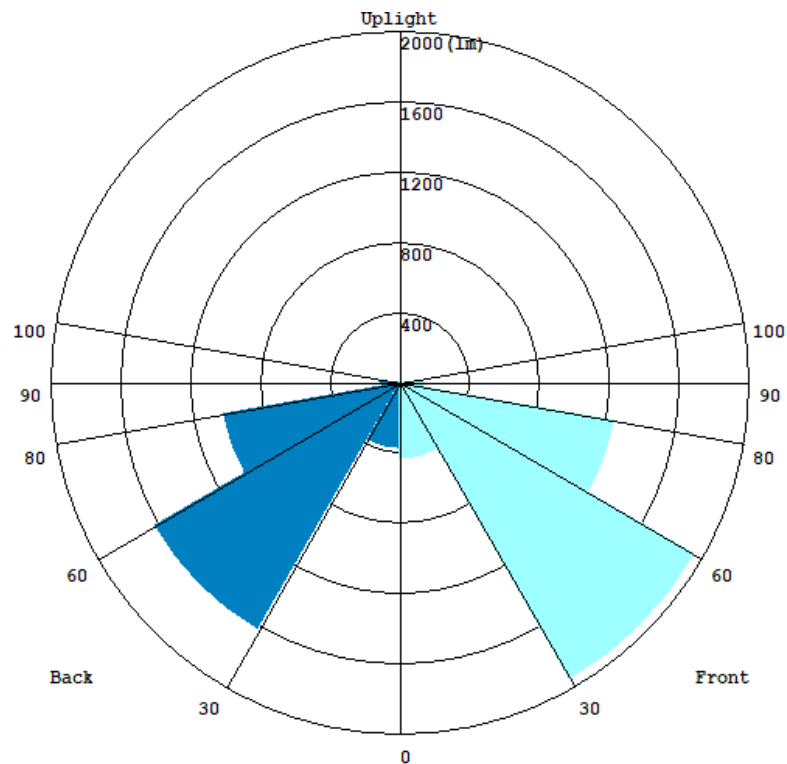

BUG-Rating

IESNA Luminaire Flux Distribution Table:

Zone	Lumens	Luminaire %
FL - Front-Low(0-30)	443.56	6.4
FM - Front-Medium(30-60)	1959.9	28.1
FH - Front-High(60-80)	1249.5	17.9
FVH - Front-Very High(80-90)	153.59	2.2
Total Forward Light	3806.5	54.7

BL - Back-Low(0-30)	379.93	5.5
BM - Back-Medium(30-60)	1630.8	23.4
BH - Back-High(60-80)	1031.2	14.8
BVH - Back-Very High(80-90)	114.83	1.6
Total Back Light	3156.8	45.3


UL - Uplight-Low(90-100)	0	0.0
UH - Uplight-High(100-180)	0	0.0
Total Up Light	0	0.0

BUG(Back,Up,Glare) Rating	B3-U0-G3
---------------------------	----------


Zone	Downward Lumens	Upward Lumens	Total Lumens
House Side	3156.8	0	3156.8
Street Side	3806.5	0	3806.5

3.2 Goniophotometer Test

Coefficients of Utilization

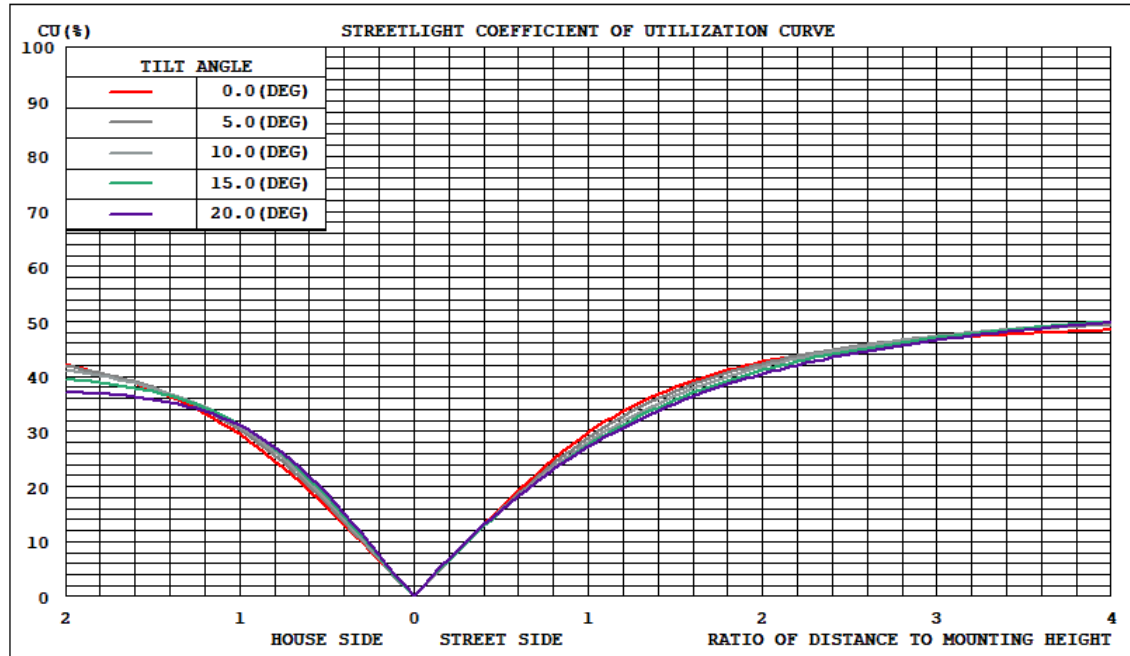


Iso-footcandle Lines of Horizontal Illumination

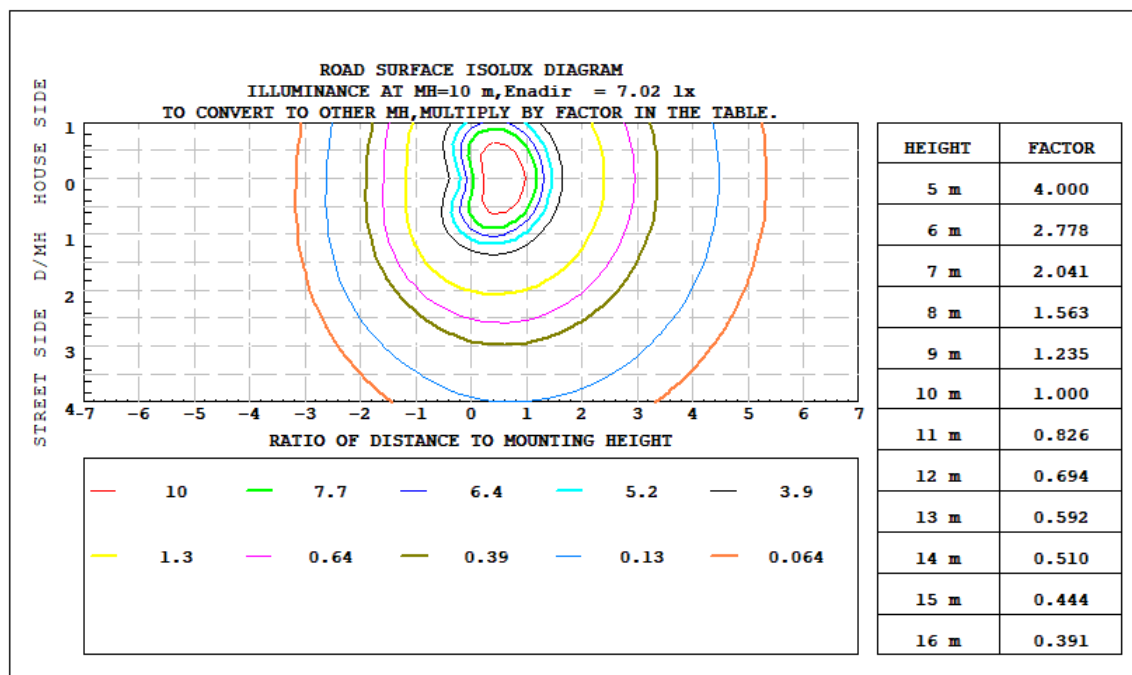

3.2 Goniophotometer Test

STREETLIGHT ISOCANDELA DIAGRAM

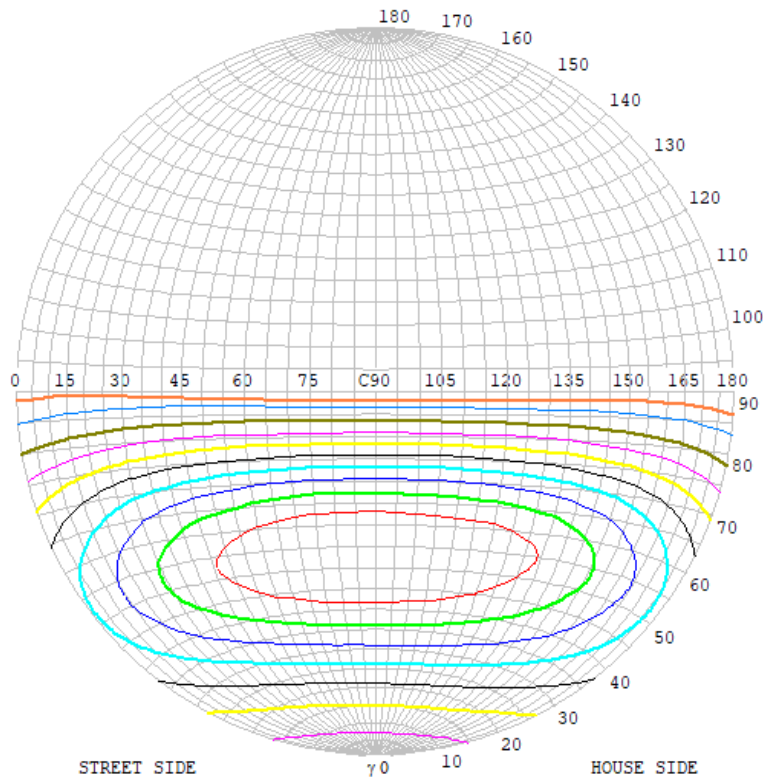


Classification:

IES:Type III - Very Short
CIE:Narrow - Short
IES:Semi cut-off
CIE:Non-cut-off
Max.At80:137.9cd/klm
Max.At90:0cd/klm
Max.80-90:137.9cd/klm

ISOCANDELA DIAGRAM	
UNIT	cd
Imax=100%	2898
90%	2608
80%	2319
70%	2029
60%	1739
50%	1449
40%	1159
30%	869
20%	580
10%	290
5%	145

ROAD ISOCANDELA REPORT

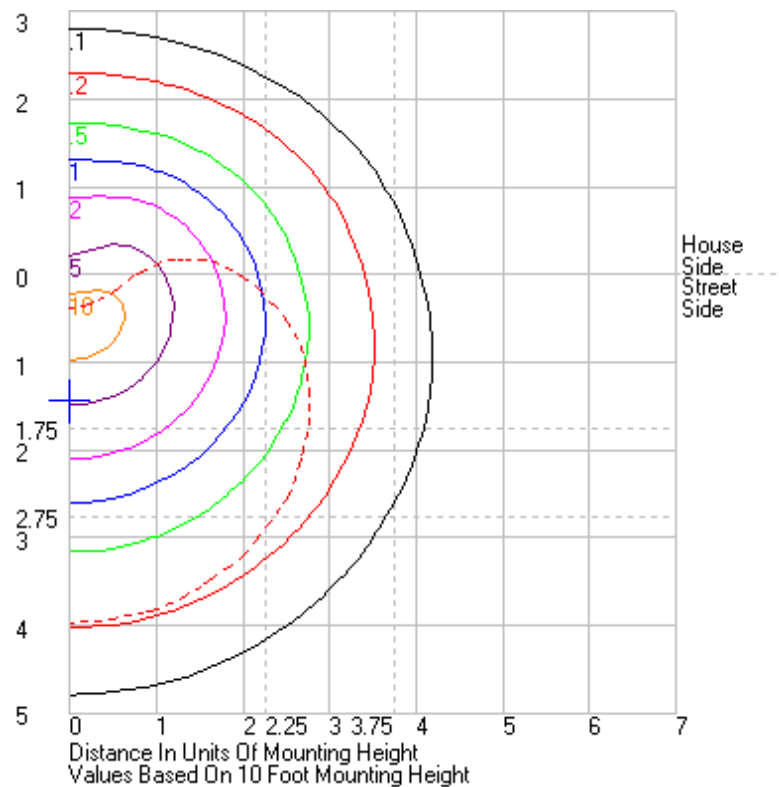

5.0 THD and PF Test

Model No.	IVAT4-75L730[H, 4]	Sample ID.	H1
-----------	--------------------	------------	----

Test Method

The samples were tested according to the ANSI C82.77:2002.

The total harmonic distortion shall be measured to the 40th order.

The ambient temperature condition was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$. The sample measurements were made using a digital power meter and power supply. The sample was operated at rated voltage and was stabilized before measurement. The total harmonic distortion were calculated.

Test Results

Temperature (°C)	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	THD
25.1	480.00	60	0.152	67.9	0.931	11.12%

6.0 Equipment Information

Test Equipment			
Equipment ID	Equipment Name	Last Calibration	Calibration Due Date
DLF107	Integrating Sphere System	2017/12/28	2018/12/27
DLF108	Auxiliary Lamp	2017/12/28	2018/12/27
DLF122	Measurement Standard Lamp Standard Lamp Type: 220 V, 0.4720 A, Tungsten, Omni-directional	2017/12/28	2018/12/27
DLF116	AC Power Source	2017/12/28	2018/12/27
DLF113	Power Meter	2017/12/28	2018/12/27
DLF112	Temperature Recorder	2017/12/28	2018/12/27
DLF114	Temperature & Humidity Datalogger	2017/12/28	2018/12/27
DLF101	Goniophotometer	2017/12/28	2018/12/27
DLF125	Standard Lamp Standard Lamp Type: 76.58 V, 6.7875 A, Tungsten, Omni-directional	2017/12/28	2018/12/27
DLF104	AC Power Source	2017/12/28	2018/12/27
DLF507	DC Power Source	2017/12/28	2018/12/27
DLF102	Power Meter	2017/12/28	2018/12/27
DLF111	Temperature & Humidity Datalogger	2017/12/28	2018/12/27
DLF119	Power Meter	2017/12/28	2018/12/27
DLF031	Temperature data logger	2017/12/28	2018/12/27
DLF022	Digital power meter	2017/12/28	2018/12/27
DLF003	Temperature & Humidity Datalogger	2017/12/28	2018/12/27

***** End of Test Report*****