

EZLED INSTALLATION INSTRUCTIONS



Thank you for buying RAB lighting fixtures. Our goal is to design the best quality products to get the job done right. We'd like to hear your comments. Call the Marketing Department at 888-RAB-1000 or email: marketing@rabweb.com



IMPORTANT


READ CAREFULLY BEFORE INSTALLING FIXTURE. RETAIN THESE INSTRUCTIONS FOR FUTURE REFERENCE.

Fixtures must be wired in accordance with the National Electrical Code and all applicable local codes. Proper grounding is required for safety. THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

WARNING: Make certain power is OFF before installing or maintaining fixture. No user serviceable parts inside.

SLIPFITTER MOUNTING

1. The slipfitter mounting fits a 2 3/8" O.D. **Tenon**. Place the slipfitter over the **Tenon** and secure the fixture with the **2 Set Screws** on the side of the slipfitter.
2. Remove 2 screws on side of **Round Cover Plate**. Remove the **Round Cover Plate** and adjust the angle of the fixture.
3. Loosen the **Locking Bolt** and swivel fixture to desired angle.
4. Tighten the **Locking Bolt** and re-attach **Round Cover Plate**.

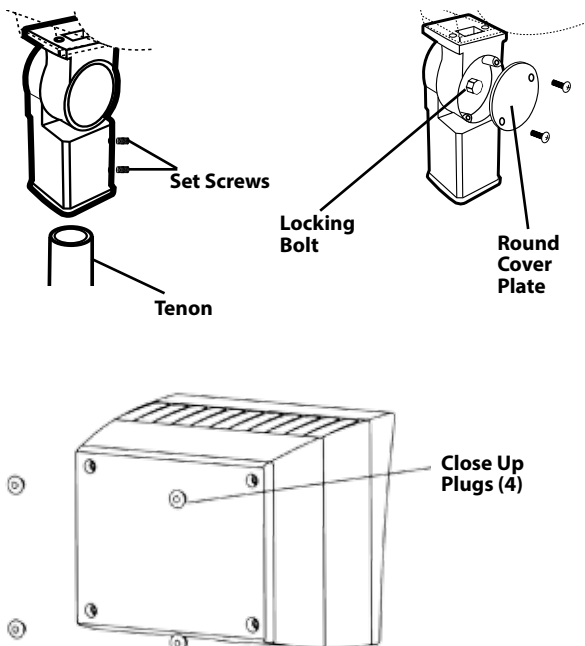


If desired, cover the screw holes with the provided **Close Up Plugs** (4) on the back cover as shown above. Tap lightly into place.

TRUNNION MOUNTING

CAUTION: UL and C-UL listed or CSA certified liquid tight cord grip suitable for use with three conductor type STW flexible cord shall be used for connection to a wet location outlet box provided by others.

To adjust the angle of the fixture using the trunnion:


1. Loosen the Pivot Bolts & angle locking screw.
2. Adjust fixture to desired angle.
3. Tighten **Pivot Bolts** & angle locking screw.

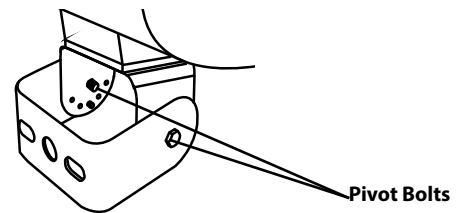

WIRING

Universal voltage drivers permits operation at 120V to 277VAC, 50 or 60 Hz.

1. Connect the **BLACK** fixture lead to the (+) **LINE** supply lead.
2. Connect the **WHITE** fixture lead to the (-) **COMMON** supply lead.
3. Connect the bare copper **Ground** wire from fixture to supply ground.

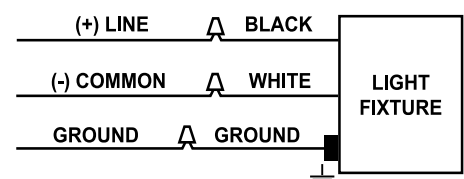

EZLED INSTALLATION INSTRUCTIONS


Thank you for buying RAB lighting fixtures. Our goal is to design the best quality products to get the job done right. We'd like to hear your comments. Call the Marketing Department at 888-RAB-1000 or email: marketing@rabweb.com

GUARD OR SHIELD INSTALLATION

Wire Guard and Poly Shield mount with (4) #8-32

Stainless Steel Screws. Screws are provided with the accessory. Guard and shield may be used together. See figure 1 for Guard. See figure 2 for Shield

1. Line up guard or shield with existing pre-drilled holes in frame as shown, tighten screws.

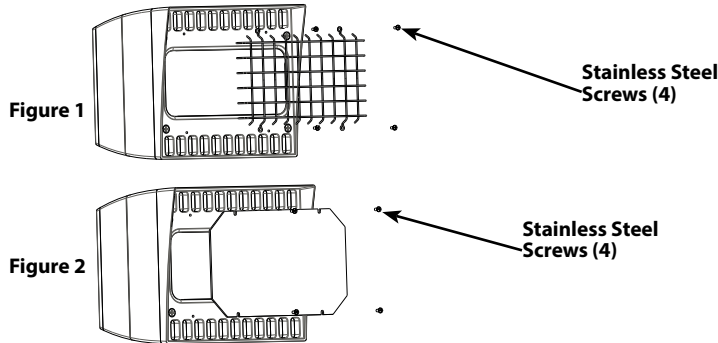

ACCESSORIES

Chrome Wire Guard:

GDEZLED78W

Poly Shield:

GDEZLED78P

Lens & Door Replacement:

LEZLED78 (bronze)

LEZLED78W (white)

TROUBLESHOOTING

1. Check that the line voltage at the fixture is correct. Refer to wiring directions.
2. Is the fixture grounded properly?
3. Is the photocell, if used, functioning properly?

CLEANING & MAINTENANCE


CAUTION: Be sure fixture temperature is cool enough to touch. Do not clean or maintain while fixture is energized.

1. Clean glass lens with non-abrasive glass cleaning solution.
2. Do not open the fixture to clean the LED. Do not touch the LED.

Pat Pending

Note: These instructions do not cover all details or variations in equipment nor do they provide for every possible situation during installation, operation or maintenance.

EZLED78 3Hx3V Cool

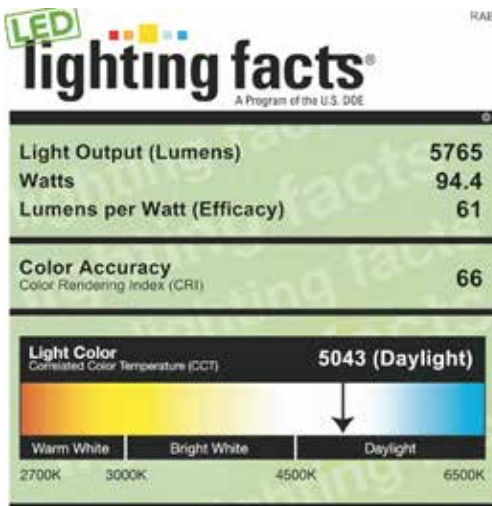

All results are according to IESNA LM-79-2009: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting. The U.S. Department of Energy (DOE) verifies product test data and results.

Visit www.lightingfacts.com for the Label Reference Guide.

Registration Number: WVMA-PS4W3Z (11/29/2012)
Model Number: EZLED78T
Type: Flood or Spotlight Fixture

EZLED78N 3H x 3V Neutral



All results are according to IESNA LM-79-2009: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting. The U.S. Department of Energy (DOE) verifies product test data and results.

Visit www.lightingfacts.com for the Label Reference Guide.

Registration Number: WVMA-7BJJKJ (11/29/2012)
Model Number: EZLED78N
Type: Flood or Spotlight Fixture

EZLED78Y 3H x 3V Warm



All results are according to IESNA LM-79-2009: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting. The U.S. Department of Energy (DOE) verifies product test data and results.

Visit www.lightingfacts.com for the Label Reference Guide.

Registration Number: WVMA-FV9HKS (11/29/2012)
Model Number: EZLED78Y
Type: Flood or Spotlight Fixture

Easy Installation & Product Help

Tech Help Line
Call our experts 888 RAB-1000

rabweb.com
Visit our website for product info

email
Answered promptly sales@rabweb.com

EZLED™ BILEVEL INSTRUCTIONS



Thank you for buying RAB lighting fixtures. Our goal is to design the best quality products to get the job done right. We'd like to hear your comments. Call the Marketing Department at 888-RAB-1000 or email: marketing@rabweb.com

IMPORTANT


READ CAREFULLY BEFORE INSTALLING FIXTURE. RETAIN THESE INSTRUCTIONS FOR FUTURE REFERENCE.

RAB fixtures must be wired in accordance with the National Electrical Code and all applicable local codes. Proper grounding is required for safety. This product must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved.

WARNING: Make certain power is OFF before installing or maintaining fixture. No user serviceable parts inside.

WIRING

1. Bi-level fixtures have LED's separated and wired as shown.
2. Each set has leads brought through the arm and labeled as shown below.
3. Use the sets for switching as needed in your application.

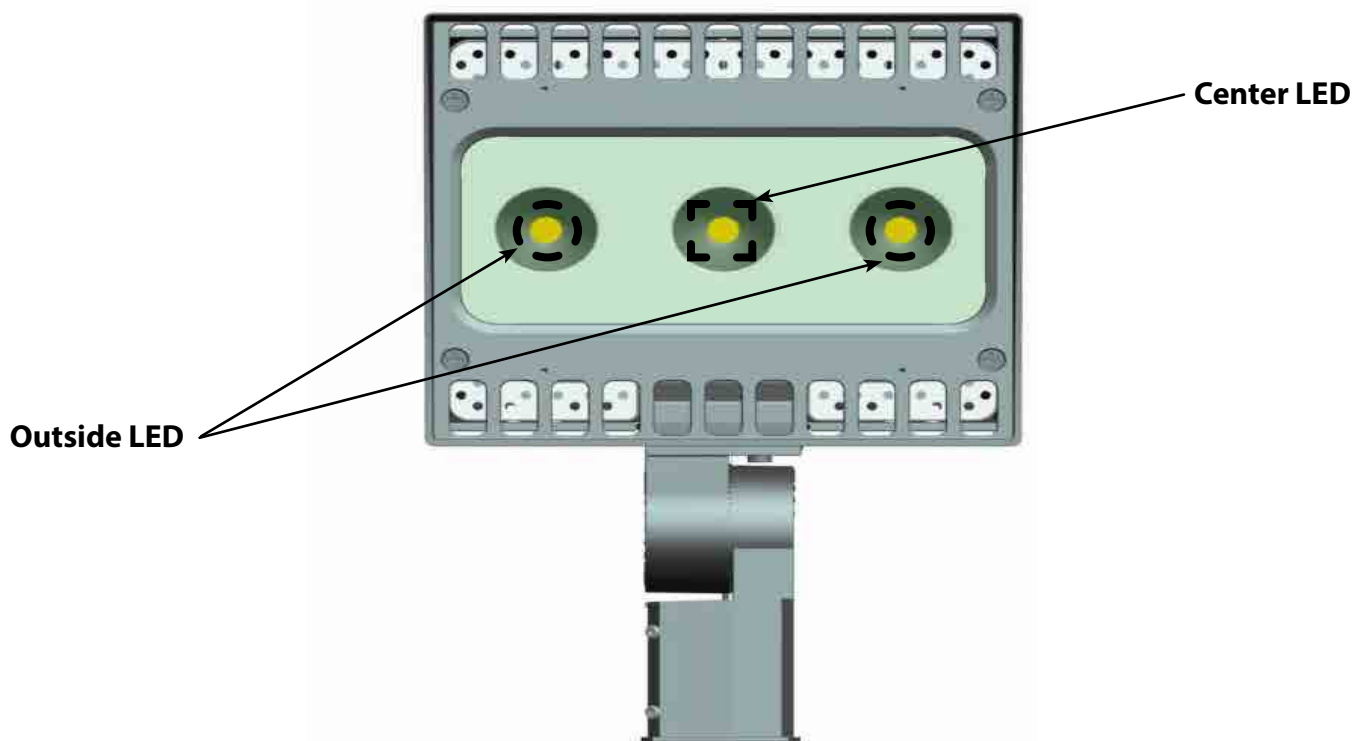

Easy Installation & Product Help

Tech Help Line
Call our experts 888 RAB-1000

rabweb.com
Visit our website for product info

email
Answered promptly sales@rabweb.com