# FIELD-ADJUSTABLE SR™ INSTALLATION



RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com



### **IMPORTANT**

#### READ CAREFULLY BEFORE INSTALLING FIXTURE. RETAIN THESE INSTRUCTIONS FOR FUTURE REFERENCE.

RAB fixtures must be wired in accordance with the National Electrical Code and all applicable local codes. Proper grounding is required for safety. THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

WARNING: Disconnect or turn OFF power at the electrical panel before installing or maintaining fixture. No User serviceable parts inside fixture.


Suitable for damp locations. Suitable for operation in ambient not exceeding 50°C.


### SURFACE MOUNTING

The fixture is suitable for indoor ceiling mounting, as follows:

- Press and hold the Release Buttons (4) on both sides of the Fixture Housing to release the Lens (Fig. 1). When pressing the Release Buttons use one hand to hold the Lens and press the Release Buttons on both sides of the Fixture with the other hand. CAUTION: The Lens may drop out quickly. Lens is supported with (2) Tether Cables (Fig. 3).
- 2. Attach both **Junction Box Cover Plates** to the **Fixture Housing** by sliding in the direction of arrows as shown in Fig. 2. Secure with (2) **Screws** (provided).
- 3. Feed supply wires through **Wire Access Hole**. Secure **Fixture Housing** to the junction box or building structure per NEC Code(*Fig. 3*).
- 4. Make electrical connections as shown in wiring diagram (Fig. 12). Use approved wiring connectors and wire to local NEC codes. Push all wires back into **Fixture Housing**. Be careful not to pinch wires.
- 5. Snap **Lens** back into **Fixture Housing** and remove protective plastic from **Lens**.

WARNING: To prevent wiring damage or abrasion, do not expose wiring to sharp objects.

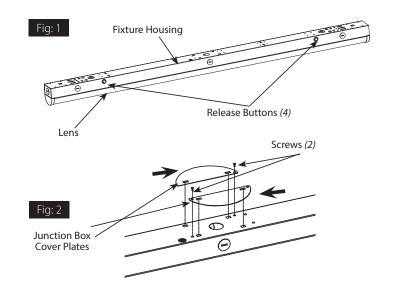

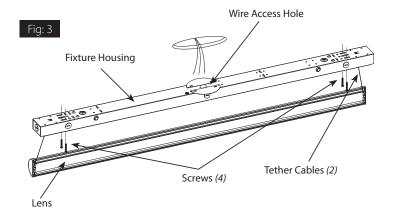

# FIELD-ADJUSTABLE SR™ INSTALLATION




RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com


# V-HOOK / CHAIN MOUNTING

The fixture can be mounted using **V-Hooks** and **Chain** (ordered separately, CAT# SR VHOOK KIT).

- 1. Loop the V-Hooks into the Mounting Slots to each end of the Fixture Housing as shown in Fig. 4.
- 2. Connect the **Chains** to the mounting surface and hang the **Fixture** from **V-Hooks** as shown in *Fig. 5*.
- 3. Fixture mounting height and spacing should be determined by application requirements. **V-Hook** and **Chain** is suitable to support four (4) times the weight of the Fixture.
- 4. Press and hold the Release Buttons (4) on both sides of the Fixture Housing to release the Lens (Fig. 1). When pressing the Release Buttons use one hand to hold the Lens and press the Release Buttons on both sides of the Fixture with the other hand. CAUTION: The Lens may drop out quickly. Lens is supported with (2) Tether Cables (Fig. 3).
- 5. Make electrical connections as shown in wiring diagram (Fig. 12). Use approved wiring connectors and suitable conduit (not provided). Wire to local NEC codes. Push all wires back into Fixture Housing. Be careful not to pinch wires.
- 6. Snap **Lens** back into **Fixture Housing** and remove protective plastic from **Lens**.

WARNING: To prevent wiring damage or abrasion, do not expose wiring to sharp objects.

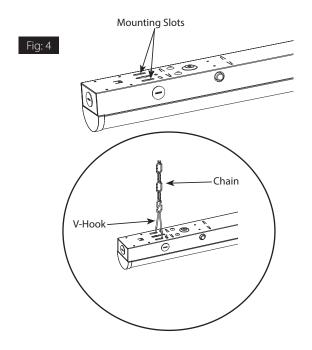

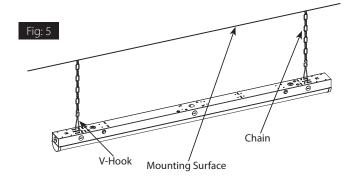

# FIELD-ADJUSTABLE SR™ INSTALLATION



RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com

### CONTINUOUS RUN MOUNTING (multiple fixtures can be mounted together)

### For Surface Mounting


(Multiple fixture wiring kit sold separately, CAT# SR JOIN KIT)

- Press and hold the Release Buttons (4) on both sides of the Fixture Housing to release the Lens (Fig. 1). When pressing the Release Buttons use one hand to hold the Lens and press the Release Buttons on both sides of the Fixture with the other hand. CAUTION: The Lens may drop out quickly. Lens is supported with (2) Tether Cables (Fig. 3).
- 2. Use a screwdriver to open the **Knockout Hole** and install the Wire Guard **(provided with Junction Box Cover Plates)** to protect wires from sharp edges (Fig. 7).
- 3. Attach both **Junction Box Cover Plates** to the **Fixture Housing** by sliding in the direction of arrows as shown in Fig. 2. Secure with (4) **Screws** (*provided*). Only one Fixture needs to be electrically hardwired from above.
- 4. Feed supply wires through **Wire Access Hole** (*Fig. 6*). Secure **Fixture Housing** to junction box or building structure.
- Make electrical connections as shown in wiring diagram (Fig. 12). Use approved wiring connectors and wire to local NEC codes. Push all wires back into Fixture Housing. Be careful not to pinch wires.
- 6. Snap Lens back into Fixture Housing and remove protective plastic from Lens.

**CAUTION:** The maximum number of fixtures allowed to be linked together is indicated in the table below (*Fig. 9*).

WARNING: To prevent wiring damage or abrasion, do not expose wiring to sharp objects.

Fig: 6

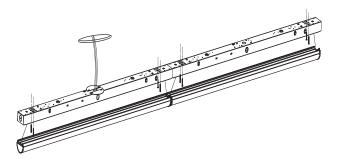

#### Fia: 9

Catalog #	Maximum Number of Linked Fixtures
SR2	Up to <b>27</b> fixtures
SR4	Up to 13 fixtures
SR8	Up to 9 fixtures

#### For V-Hook/Chain Mounting


(Multiple fixture wiring kit sold separately, CAT# SR JOIN KIT)


- 1. Use a screwdriver to open the **Knockout Hole** and install the **Wire Guard** (*provided with Junction Box Cover Plates*) to protect wires from sharp edges (*Fig. 7*).
- 2. Install **Joiner Bracket** to connect multiple fixtures together and secure with (8) **Screws** (Fig. 8).
- 3. Connect the **Chains** to the mounting surface and hang Fixture from the V-Hooks as shown in Fig. 5
- 4. Fixture mounting height and spacing should be determined by application requirements. **V-Hook** and **Chain** is suitable to support four (4) times the weight of the fixture.
- 5. Press and hold the Release Buttons (4) on both sides of the Fixture Housing to release the Lens (Fig. 1). When pressing the Release Buttons use one hand to hold the Lens and press the Release Buttons on both sides of the Fixture with the other hand. CAUTION: The Lens may drop out quickly. Lens is supported with (2) Tether Cables (Fig. 3).
- 6. Make electrical connections as shown in wiring diagram (Fig. 12). Use approved wiring connectors and suitable conduit (not provided). Wire to local NEC codes. Be careful not to pinch wires.
- 7. Snap **Lens** back into **Fixture Housing** and remove protective plastic from **Lens**.

**CAUTION:** The maximum number of fixtures allowed to be linked together is indicated in the table below (*Fig. 9*).


WARNING: To prevent wiring damage or abrasion, do not expose wiring to sharp objects.

Fig: 7





Wire Guard

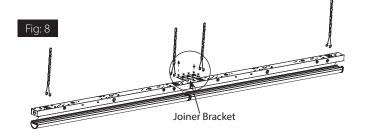

# FIELD-ADJUSTABLE SR™ INSTALLATION



RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com


### FIELD ADJUSTMENT

Follow instructions below to change the **Fixture Power** (*W*) and/or **Color Temperature** (*CCT*) from factory settings:

### **Factory Settings:**

SR2 19/14/10W 19W / 4000K SR4 40/30/20W 40W / 4000K SR8 60/50/40W 60W / 4000K

- 1. Locate the **Field Adjustable Switches** on the side of **Fixture Housing** as shown in Fig. 10.
- 2. Select Power (W) and Color Temperature (CCT) by sliding respective switch to the desired value (Fig. 10).

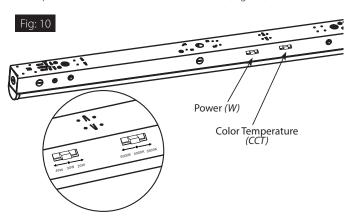

### PIR MODELS

Screw **Sensor Head** onto the **Bracket** as shown in Fig. 11. See factory settings below (optional remote sold separately for custom settings, CAT# MSR1).

### Factory Settings:

• Brightness: 100%


• Sensitivity: 50%

• Hold Time: 1 Minute

• Stand-by dimming level: 20%

Daylight: Disabled

Stand-by time: 1 Minute



## MVS MODELS (Internal)


(optional remote sold separately for custom settings, CAT# MSR1).

• Sensitivity: 100%

### 0-10V DIMMABLE WIRING

RISK OF FIRE. Universal voltage driver permits operation at 120V through 277V, 50 or 60 Hz. For 0-10V dimming follow the wiring directions as shown in Fig. 12.

- 1. Connect the black fixture lead to the LINE supply lead.
- 2. Connect the white fixture lead to the COMMON supply lead.
- 3. Connect the green GROUND wire from fixture to supply ground.
- 4. Connect the purple fixture lead to the (V+) DIM lead.
- 5. Connect the pink fixture lead to the (V-) DIM lead.
- 6. Cap the yellow fixture lead, if present. Do NOT connect.

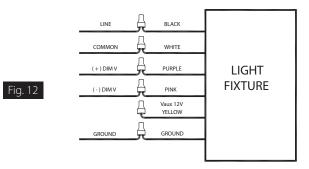

## SR VHOOK ACCESSORY KIT

SR VHOOK Kit includes the following:

• 40" Chain (2) • V-Hooks (2)

## SR JOIN ACCESSORY KIT

SR JOIN Kit includes the following:

- Joiner Bracket w/ 8 Screws
- Nuts (12)
- Wires (12 Tinned copper)

### TROUBLESHOOTING

- 1. Check that the line voltage at the fixture is correct. Refer to wiring diagram.
- 2. Be sure the fixture is grounded properly.

## **CLEANING & MAINTENANCE**

CAUTION: Be sure fixture temperature is cool enough to touch. Do not clean or maintain while fixture is energized.

- 1. Clean polycarbonate lens with non-abrasive cleaning solution.
- 2. Do not open the fixture to clean the LEDs. Do not touch the LEDs.

**Note:** These instructions do not cover all details or variations in equipment nor do they provide for every possible situation during installation, operation or maintenance.



P-100266